
## **Notching and Boring Guidelines**





Reference: 2024 International Residential Code


Contractors/homeowners can compromise the structural integrity of a building member by incorrectly cutting, notching, or drilling structural and non-structural members. The following information is a guide and does not necessarily cover all types of members.

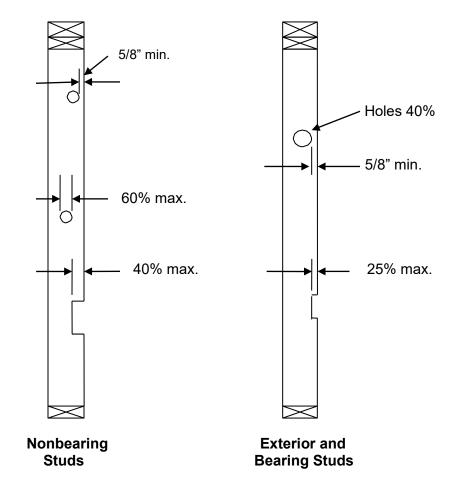


- ➤ **NOTCHING** Any stud in an <u>exterior wall or bearing partition</u> may be cut or notched to a depth not exceeding 25% of its width. Studs in <u>nonbearing</u> partition may be notched to a depth not to exceed 40% of a single stud width.
- ➤ **DRILLING** Any stud may be bored or drilled, provided that diameter of the resulting hole is no more than 60% of the stud width and the edge of the hole is no more than 5/8" to the edge of the stud, and the hole is not located in the same area as a cut or notch. Studs located in <u>exterior walls or bearing partitions</u> drilled over 40% and up to 60% shall also be doubled with no more than 2 successive doubled studs bored.

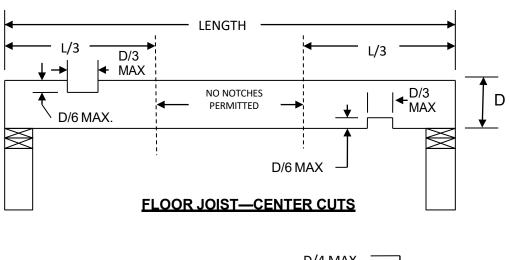

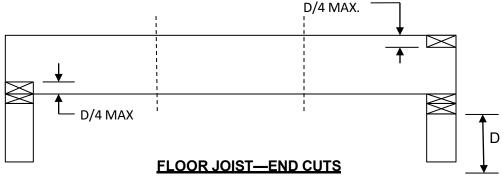

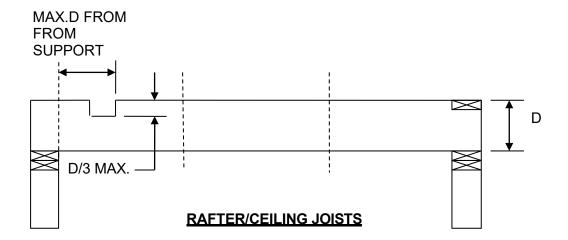

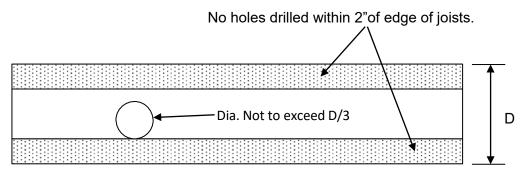

(Diagrams are not to scale.)

## **NOTCHING & BORING LIMITS**

- ➤ Ends of joists notches: equal to or less than ¼ depth (D).
- > Top or bottom of joists notches: equal to or less than 1/6th the depth (D).
- Notches shall not be located in the center 1/3 of the span.
- > Bored holes shall not be within 2 inches of the top or bottom of the joists.
- > The hole diameter shall not exceed 1/3 the depth of the joists.
- ➤ Holes are to be separated by a min. of 2".
- > No holes are to be drilled with 2" of a notch.

**Engineered wood products**—Cuts, notches, and holes bored in I-joists, trusses, laminated veneer lumber, and glue-laminated members are **not permitted** unless the effects of such penetrations are specifically considered in the design by the manufacturer.

| ALLOWABLE NOTCH AND BORED HOLE DIMENSIONS* |         |        |        |        |                  |        |                     |
|--|---------|--------|--------|--------|------------------|--------|---------------------|
| JOISTS AND RAFTERS                         |         |        |        |        | BEARING<br>STUDS |        | NONBEARING<br>STUDS |
| NOMINAL                                    | ACTUAL  | D/6    | D/4    | D/3    | .25D             | .40D   | .60D                |
| 4"   | 3 ½"    | 9/16"  | 7/8"   | 1 1/8" | 7/8"             | 1 3/8" | 2 1/8"              |
| 6"   | 5 ½"    | 7/8"   | 1 3/8" | 1 7/8" | 1 3/8"           | 2 1/4" | 3 1⁄4"              |
| 8"   | 7 1⁄4"  | 1 1⁄4" | 1 7/8" | 2 3/8" | 1 7/8"           | 2 7/8" | 4 3/8"              |
| 10"  | 9 1/4"  | 1 ½"   | 2 3/8" | 3 1/8" |                  |        |                     |
| 12"  | 11 1⁄4" | 1 7/8" | 2 7/8" | 3 3/4" |                  |        |                     |
| 14"  | 13 1⁄4" | 2 1/4" | 3 3/8" | 4 3/8" |                  |        |                     |

<sup>\*</sup>The above dimensions are guidelines and are approximate.